

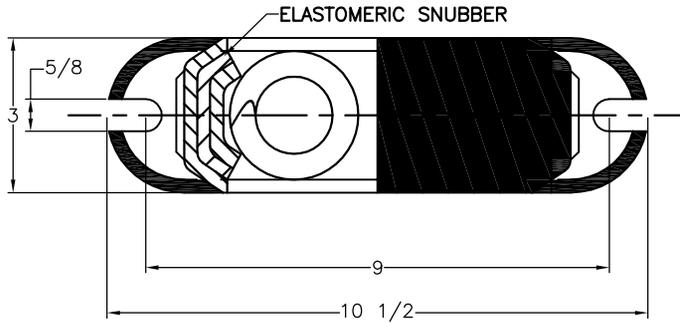


REV.	DESCRIPTION	DATE	BY

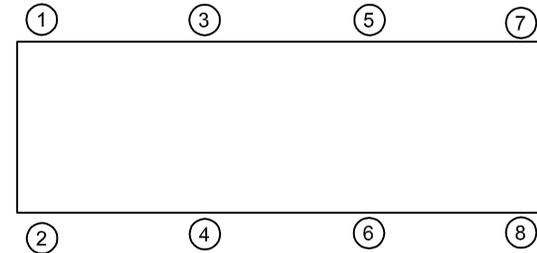

TYPE C2DT-2B CAST IRON SPTING-FLEX MOUNTINGS WITH INTERNAL ADJUSTMENT				
MODEL	MAX LOAD (LBS.)	DEFLECTION (IN)	RATE (LB/IN)	SPRING COLOR CODE
C2DT-2B-380	380	2.13	178	BLACK
C2DT-2B-700	700	1.86	376	RED
C2DT-2B-1100	1100	1.54	714	GRAY
C2DT-2B-1330N ¹	1330	1.54	864	GRAY/ORANGE
C2DT-2B-1530N ¹	1530	1.54	994	GRAY/DK BROWN

NOTES:
 1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE IS FOR OUTER SPRING/INNER SPRING.

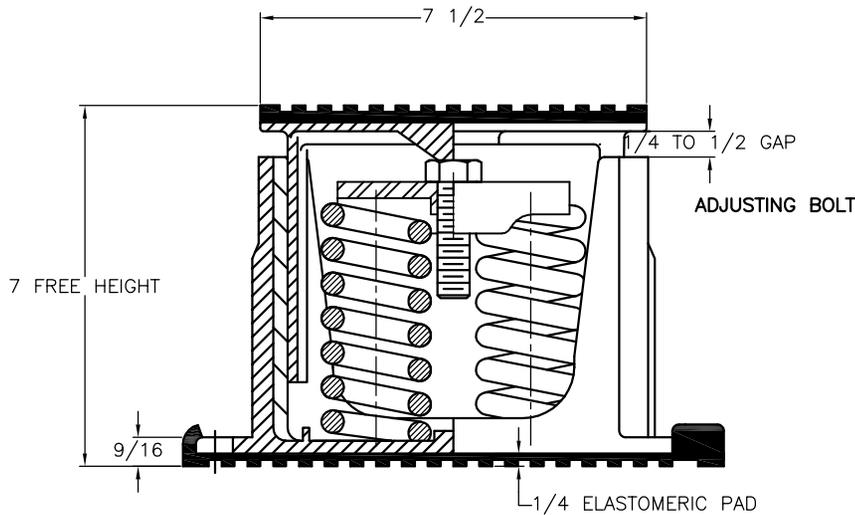

ISOLATOR SELECTIONS	
LOC 1:	LOC 2:
LOC 3:	LOC 4:
LOC 5:	LOC 6:
LOC 7:	LOC 8:
CUSTOMER EQP'T. TAG:	

NOTE: MATERIAL SHOWN IS FOR (1) SET.

- ALL DIMENSIONS ARE IN INCHES. INTERPRET PER ANSI Y-14.
- FINISH: HOUSING CAST IRON- ONE COAT BLACK PAINT, SPRINGS:- POWDER COAT, HARDWARE- ZINC ELECTROPLATE.
- REFER TO DRAWING 2 OF 2 FOR INSTALLATION INSTRUCTIONS.
- INNER SPRING (WHEN USED) NOT SHOWN.
- MOST SPRINGS ARE DESIGNED WITH 50% OVER-TRAVEL.
- RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL. HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

**MODEL C2DT-2B 380-1530 LBS.
 HOUSED CAST IRON SPRING FLEX MOUNTS
 SNUBBED WITH INTERNAL ADJUSTMENT
 2 INCH DEFLECTION**




THE VMC GROUP
The Power of Together
 Bloomingdale, NJ 07403
 Houston, TX 77041

SCALE: NONE	
SHEET: 1 OF 2	
DRAWING NO.:	REVISION

REV.	DESCRIPTION	DATE	BY
5			

INSTALLATION INSTRUCTION

1. ISOLATORS ARE SHIPPED FULLY ASSEMBLED AND ARE TO BE SPACED AND ARRANGED IN ACCORDANCE WITH INSTALLATION DRAWINGS OR AS OTHERWISE RECOMMENDED.
2. SET ISOLATORS ON FLOOR OR SUB-BASE, ENSURING THAT ALL ISOLATOR CENTERLINES MATCH THE EQUIPMENT MOUNTING HOLES. SHIM OR GROUT AS REQUIRED LEVELING ALL ISOLATOR BASE PLATES "E" AT THE SAME ELEVATION (1/4" MAXIMUM DIFFERENCE IN ELEVATION CAN BE TOLERATED). ISOLATOR BASE PLATES MUST REST ON A FLAT SURFACE.
3. ONCE ISOLATORS ARE IN POSITION, PLACE BLOCKING ALONGSIDE ISOLATORS. BLOCKING HEIGHT SHOULD BE EQUIVALENT TO THE FREE HEIGHT OF THE ISOLATOR AND BE CAPABLE OF SUPPORTING EQUIPMENT WEIGHT.
4. UNLESS SPECIFIED, MOUNTINGS NEED NOT BE FASTENED TO FLOOR IN ANY WAY. IF REQUIRED, BOLT MOUNTINGS TO FLOOR THROUGH SLOTS "D".
5. PLACE MACHINE OR EQUIPMENT ONTO TOP PLATE "A" OF ISOLATOR. THE WEIGHT OF THE MACHINE WILL CAUSE THE UPPER HOUSING OF THE MOUNT TO GO DOWN, POSSIBLY RESTING ON THE LOWER HOUSING.
6. ADJUST EACH ISOLATOR IN SEQUENCE: SCREW DOWN ONE COMPLETE TURN ON THE THE ADJUSTING BOLT "B" OF EACH MOUNTING. ADJUST UNTIL 1/4" GAP IS OBTAINED ON ALL MOUNTS.
7. INSTALLATION COMPLETE.

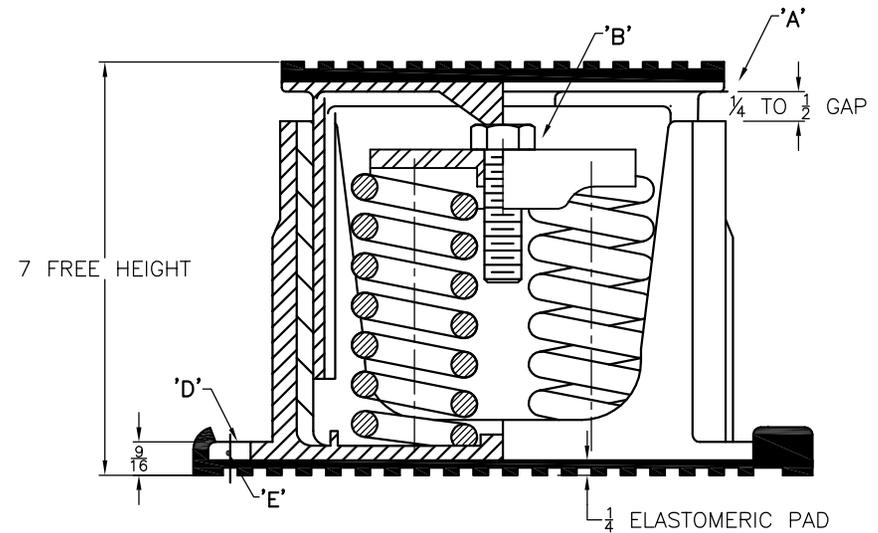

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

**MODEL C2DT-2B 380-1530 LBS.
 HOUSED CAST IRON SPRING FLEX MOUNTS
 SNUBBED WITH INTERNAL ADJUSTMENT
 2 INCH DEFLECTION**



THE VMC GROUP
The Power of Together
 Bloomingdale, NJ 07403
 Houston, TX 77041

SCALE:
NONE

SHEET:
2 OF 2

DRAWING NO.:

REVISION

