

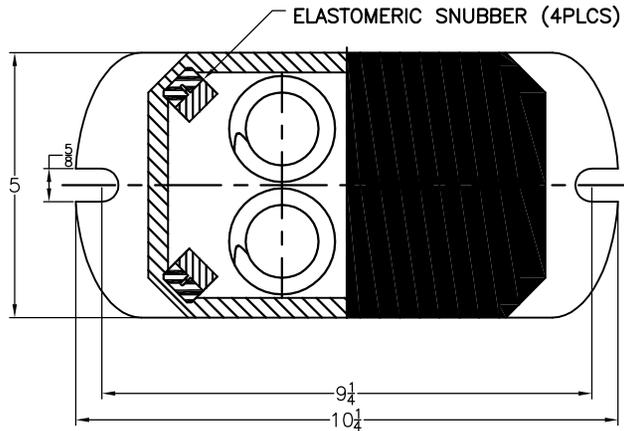


REV.	DESCRIPTION	DATE	BY

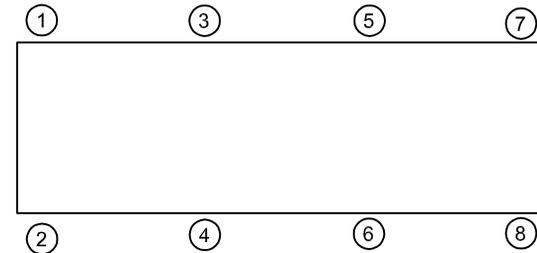

TYPE C4DT-2B CAST IRON SPRING-FLEX MOUNTINGS WITH INTERNAL ADJUSTMENT				
MODEL	MAX LOAD (LBS)	DEFLECTION (IN)	SPRING RATE (LB/IN)	SPRING COLOR CODE
C4DT-2B-760	760	2.13	356	BLACK
C4DT-2B-1400	1400	1.86	752	RED
C4DT-2B-2200	2200	1.54	1428	GRAY
C4DT-2B-2660N ¹	2660	1.54	1728	GRAY/ORANGE
C4DT-2B-3060N ¹	3060	1.54	1988	GRAY/DK BROWN

NOTES:
 1. TWO NESTED SPRINGS YIELD THIS LOAD. THE COLOR CODE INDICATED IS FOR OUTER SPRING/ INNER SPRING.

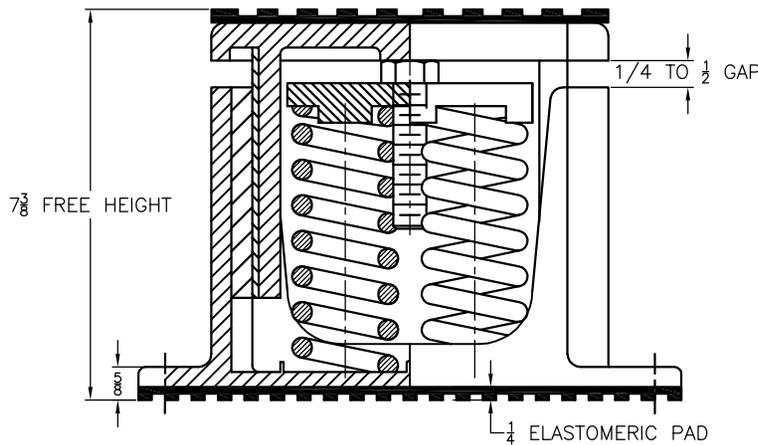

ISOLATOR SELECTIONS	
LOC 1:	LOC 2:
LOC 3:	LOC 4:
LOC 5:	LOC 6:
LOC 7:	LOC 8:
CUSTOMER EQP'T. TAG:	

- NOTES:**
1. ALL DIMENSIONS ARE IN INCHES, INTERPRET PER ANSI Y14.
 2. FINISH: HOUSINGS-CAST IRON- ONE COAT BLACK PAINT, SPRINGS-POWER COAT, HARDWARE- ZINC ELECTROPLATE.
 3. REFER TO SHEET 2 OF 2 FOR INSTALLATION INSTRUCTIONS.
 4. INNER SPRING (WHEN USED) NOT SHOWN.
 5. ALL SPRINGS ARE DESIGNED WITH 50% OVER TRAVEL.
 6. RATED DEFLECTIONS ARE WITHIN 25% OF NOMINAL. HIGHER DEFLECTIONS ARE ALLOWED IF THEY MEET SPECIFICATIONS.

NOTE: MATERIAL SHOWN IS FOR (1) SET.

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____

CUSTOMER: _____

CUSTOMER P.O.: _____

SALES ORDER: _____

**MODEL C4DT-2B 760-3060 LBS. HOUSED
 CAST IRON SPRING-FLEX MOUNTS
 SNUBBED WITH INTERNAL ADJUSTMENT
 2 INCH DEFLECTION**



SCALE: NONE

SHEET: 1 OF 2

DRAWING NO.: _____


REVISION: _____

Member VISCMA

REV.	DESCRIPTION	DATE	BY

INSTALLATION INSTRUCTION

1. ISOLATORS ARE SHIPPED FULLY ASSEMBLED AND ARE TO BE SPACED AND ARRANGED IN ACCORDANCE WITH INSTALLATION DRAWINGS OR AS OTHERWISE NOTED RECOMMENDED.
2. SET ISOLATORS ON FLOOR OR SUB-BASE, ENSURING THAT ALL ISOLATOR CENTERLINES MATCH THE EQUIPMENT MOUNTING HOLES. SHIM OR GROUT AS REQUIRED LEVELING ALL ISOLATOR BASE PLATES "E" AT THE SAME ELEVATION (1/4" MAXIMUM DIFFERENCE IN ELEVATION CAN BE TOLERATED). ISOLATOR BASE PLATES MUST REST ON A FLAT SURFACE.
3. ONCE ISOLATORS ARE IN POSITION, PLACE BLOCKING ALONGSIDE ISOLATOR. BLOCKING HEIGHT SHOULD BE EQUIVALENT TO THE FREE HEIGHT OF THE ISOLATOR AND BE CAPABLE OF SUPPORTING WEIGHT.
4. UNLESS SPECIFIED, MOUNTINGS NEED NOT BE FASTENED TO FLOOR IN ANY WAY. IF REQUIRED, BOLT MOUNTINGS TO FLOOR THROUGH SLOTS "D".
5. PLACE MACHINE OR EQUIPMENT ONTO TOP PLATE "A" OF ISOLATOR. THE WEIGHT OF THE MACHINE WILL CAUSE THE UPPER HOUSING OF THE MOUNT TO GO DOWN, POSSIBLY RESTING ON THE LOWER HOUSING.
6. ADJUST EACH ISOLATOR IN SEQUENCE; SCREW DOWN ONE COMPLETE TURN ON THE ADJUSTING BOLT "B" OF EACH MOUNTING. ADJUST UNTIL 1/4" GAP IS OBTAINED ON ALL MOUNTS.
7. INSTALLATION IS COMPLETE.

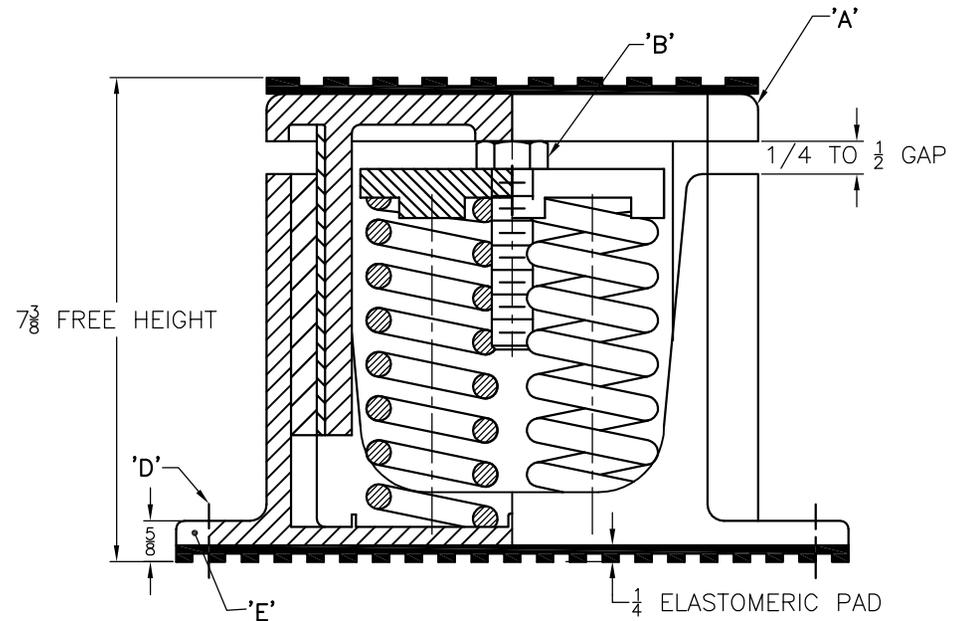

OTHER MATERIALS, COMPOUNDS, OR FINISHES WITH EQUAL OR SUPERIOR PROPERTIES MAY BE SUBSTITUTED AS THEY BECOME AVAILABLE.

CERTIFIED FOR:

JOB NAME: _____
 CUSTOMER: _____
 CUSTOMER P.O.: _____
 SALES ORDER: _____

**MODEL C4DT-2B 760-3060 LBS. HOUSED
 CAST IRON SPRING-FLEX MOUNTS
 SNUBBED WITH INTERNAL ADJUSTMENT
 2 INCH DEFLECTION**



THE VMC GROUP
The Power of Together
 Bloomingdale, NJ 07403
 Houston, TX 77041

SCALE:

NONE

SHEET:

2 OF 2

DRAWING NO.:

REVISION

